



## GRATE FRAME

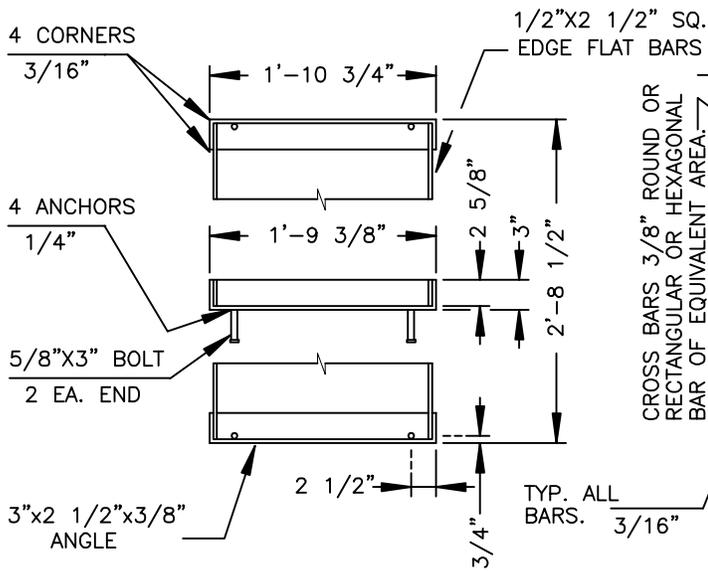

## GRATE


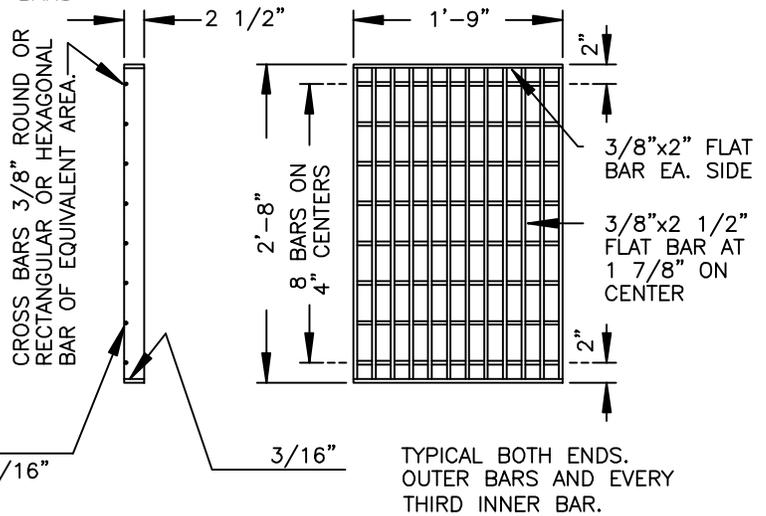


**NOTE:** 3/8" CROSS BARS SHALL BE FLUSH WITH THE GRATE SURFACE AND MAY BE FILLET WELDED, RESISTANCE WELDED OR ELECTROFORGED TO BEARING BARS.

**NOTE:** OVERSIZE CATCH BASIN (G-2)  
INSIDE DIMENSIONS WILL BE 2'-4" x 2'-4"  
GRATE AND FRAME WILL ADJUST ACCORDINGLY


**NOTES:**

1. PRECAST BASE WALLS MAY BE A MINIMUM OF 4" THICK.
2. CONCRETE SHALL BE CLASS 3000.
3. APP. CAST IRON FRAMES & GRATES MAY BE ACCEPTED.
4. POURED IN PLACE OR APPROVED PRECAST MAY BE USED.

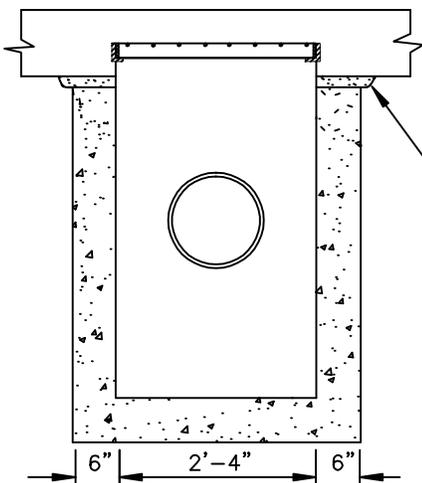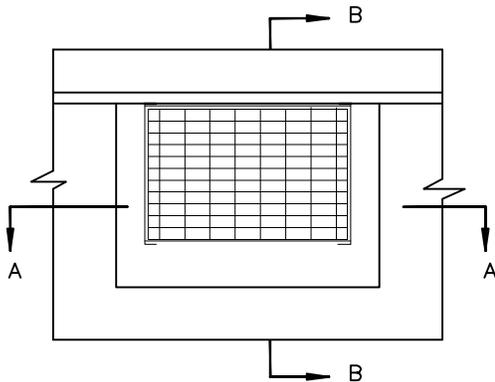

SECTION A-A

GROUT BETWEEN TOP OF CATCH BASIN AND BOTTOM OF CURB AND GUTTER

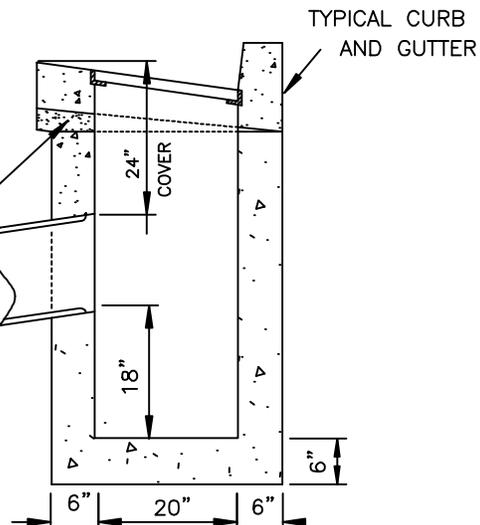

SECTION B-B



## DETAIL FOR CATCH BASIN

DATE: AUGUST 2009

DRAWING NO. 10