


SECTION A-A

NOTES:

- 1) CONTACT THE US POSTAL SERVICE FOR LOCATION OF MAILBOX UNITS. LOCATION SUBJECT TO APPROVAL BY THE CITY.
- 2) PROVIDE AN UNOBSTRUCTED ACCESS PAD MEASURING NOT LESS THAN 6' WIDE BY 6' LONG CENTERED ON THE MAILBOX UNIT. ADJACENT SIDEWALKS MAY BE USED IN MEASURING THE AREA OF THE ACCESS PAD.
- 3) WHEN LOCATED WITHIN A PLANTER STRIP, CONCRETE PAD SHALL EXTEND FROM THE BACK OF CURB TO EDGE OF SIDEWALK.
- 4) THE ACCESS PAD SHALL HAVE A SLOPE NO GREATER THAN 1.75% IN ANY DIRECTION.
- 5) MAILBOX UNITS SHALL BE CONNECTED BY A CONTINUOUS ACCESSIBLE WAY TO A CURB RAMP LOCATED NO GREATER THAN 50' AWAY.
- 6) CONCRETE SHALL HAVE A 28 DAY ULTIMATE COMPRESSIVE STRENGTH OF 3500 PSI
- 7) ALL WORK SHALL COMPLY WITH CURRENT PROWAG GUIDELINES AND CHAPTER 11 OF 2010 OREGON STRUCTURAL SPECIALTY CODE.

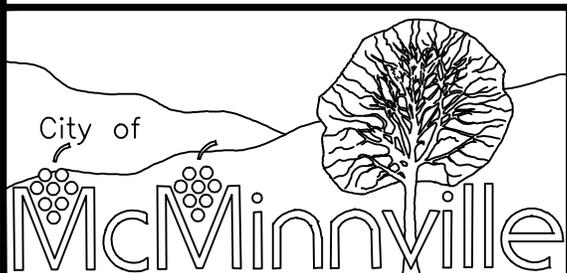

DETAIL FOR
CLUSTERED MAILBOX UNITS

DATE: DEC 2013

DRAWING NO. 35