

APPROVED PIPE MATERIAL:  
 3" MINIMUM DIAMETER  
 PVC, ABS, HDPE, CAST IRON

18 GAUGE GREEN  
 TRACER WIRE


PIPE BEDDING  
 3/4" MINUS  
 CRUSHED  
 AGGREGATE

3" MIN      3" MIN  
 OUTSIDE  
 DIAMETER

3" MIN. BEDDING BELOW  
 OUTSIDE OF PIPE BELL

UNDISTURBED  
 NATIVE SOIL

NOTES:  
 MINIMUM PIPE SLOPE 2% (1/4 INCH PER FOOT)  
 CLEANOUT WITHIN 2 FEET OF HOUSE  
 CLEANOUT EVERY 100 FEET AND/OR 135 DEGREES OF BEND

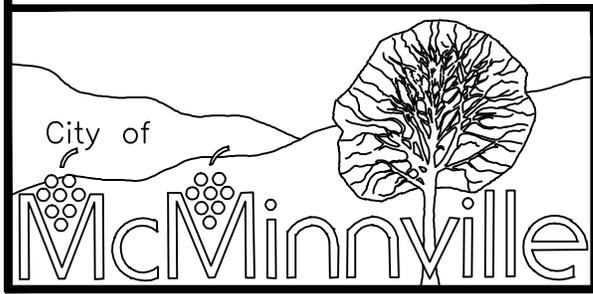

<p>DETAIL FOR          TRENCH BACKFILL          PRIVATE PROPERTY</p>	
<p>DATE:          FEBRUARY 2011</p>	<p>DRAWING NO.          9B</p>